

MODULES:
 180 PV SOLAR MODULES, 1 PV MODULE PER MICROINVERTER
 - 550W PV MODULES ON UL 2703 LISTED RACKING
 - BARE 12 AWG EGC BONDED TO RACKING WITH UL LISTED LUGS
 - EACH MODULE EFFECTIVELY BONDED TO RACKING.

MICROINVERTER:
 180 MODULE LEVEL MICROINVERTER, MAXIMUM 12 PER BRANCH CIRCUIT
 - ENPHASE, IQ8P-3P-72-E-US MICROINVERTERS
 - UL 1741, NEMA 4, 208VAC, 2.26A L-L, FUNCTIONALLY GROUNDING

BRANCH CIRCUIT CURRENT :
 4 (MICROS PER PHASE) X 2.26A (IQ8P-3P CURRENT) X 1.732 X 1.25= 19.6A

COMBINED CIRCUIT CURRENT :
 60 (MICROS PER PHASE) X 2.26A (IQ8P-3P CURRENT) X 1.732 X 1.25= 293.5A

NOTE: CENTER FEEDING RECOMMENDED FOR ALL INSTALLATIONS WITH >9 MICROINVERTERS IN BRANCH CIRCUIT ; END FEEDING RECOMMENDED FOR <= 9 MICROS IN BRANCH CIRCUIT


System Details

SYSTEM SIZE (DC)	SYSTEM SIZE (AC)	DC/AC RATIO
99.0kW	86.4kW	1.15

Enphase BOM

SYSTEM COMPONENT	SKU DETAILS	QUANTITY
IQ8P-3P	IQ8P-3P-72-E-US	180
EN4 TO MC4 bulkhead adapter cable	ECA-EN4-S22 (Default Supply with IQ8P-3P)	180 Pairs
QD CABLE	QD-12-13-120 (1.6 m pitch) OR QD-12-20-120 (2.3 m pitch) OR QD-12-25-108 (2.8 m pitch)	180 Drops (Assumption: No drops skipped)
Cable Termination	QD-TERM-10	3 (SKU of 10 Units)
Cable Clip	ET-CLIP-100	Based on Site
Disconnect Tool	QD-DISC-10	1 (SKU of 10 Units)
Sealing Cap	QD-SEAL-10	Based on Site
Center Feeding Adapter cable	QD-LINKFW-10	2 (SKU of 10 Units) for center feeding using CTAP connector
Field Wireables	QD-CONN-10M	2 (SKU of 10 Units) Only male connector shall be required for center feeding using QD-LINKFW-10
Communication Gateway	ENV-IQ8-AM3-3P	1
Production CTs	CT-400-SOLID	400A-3 CTs default Supply
Consumption CTs	CT-600-SPLIT	600A-3 (Optional)
Power Line Filters	QD-LCF-400-3P	400A - 1 (Conditional)

* Above BOM contains only Enphase system components
 ** Power Line Filters should be installed if site loads generate electrical noise that disrupt communications.

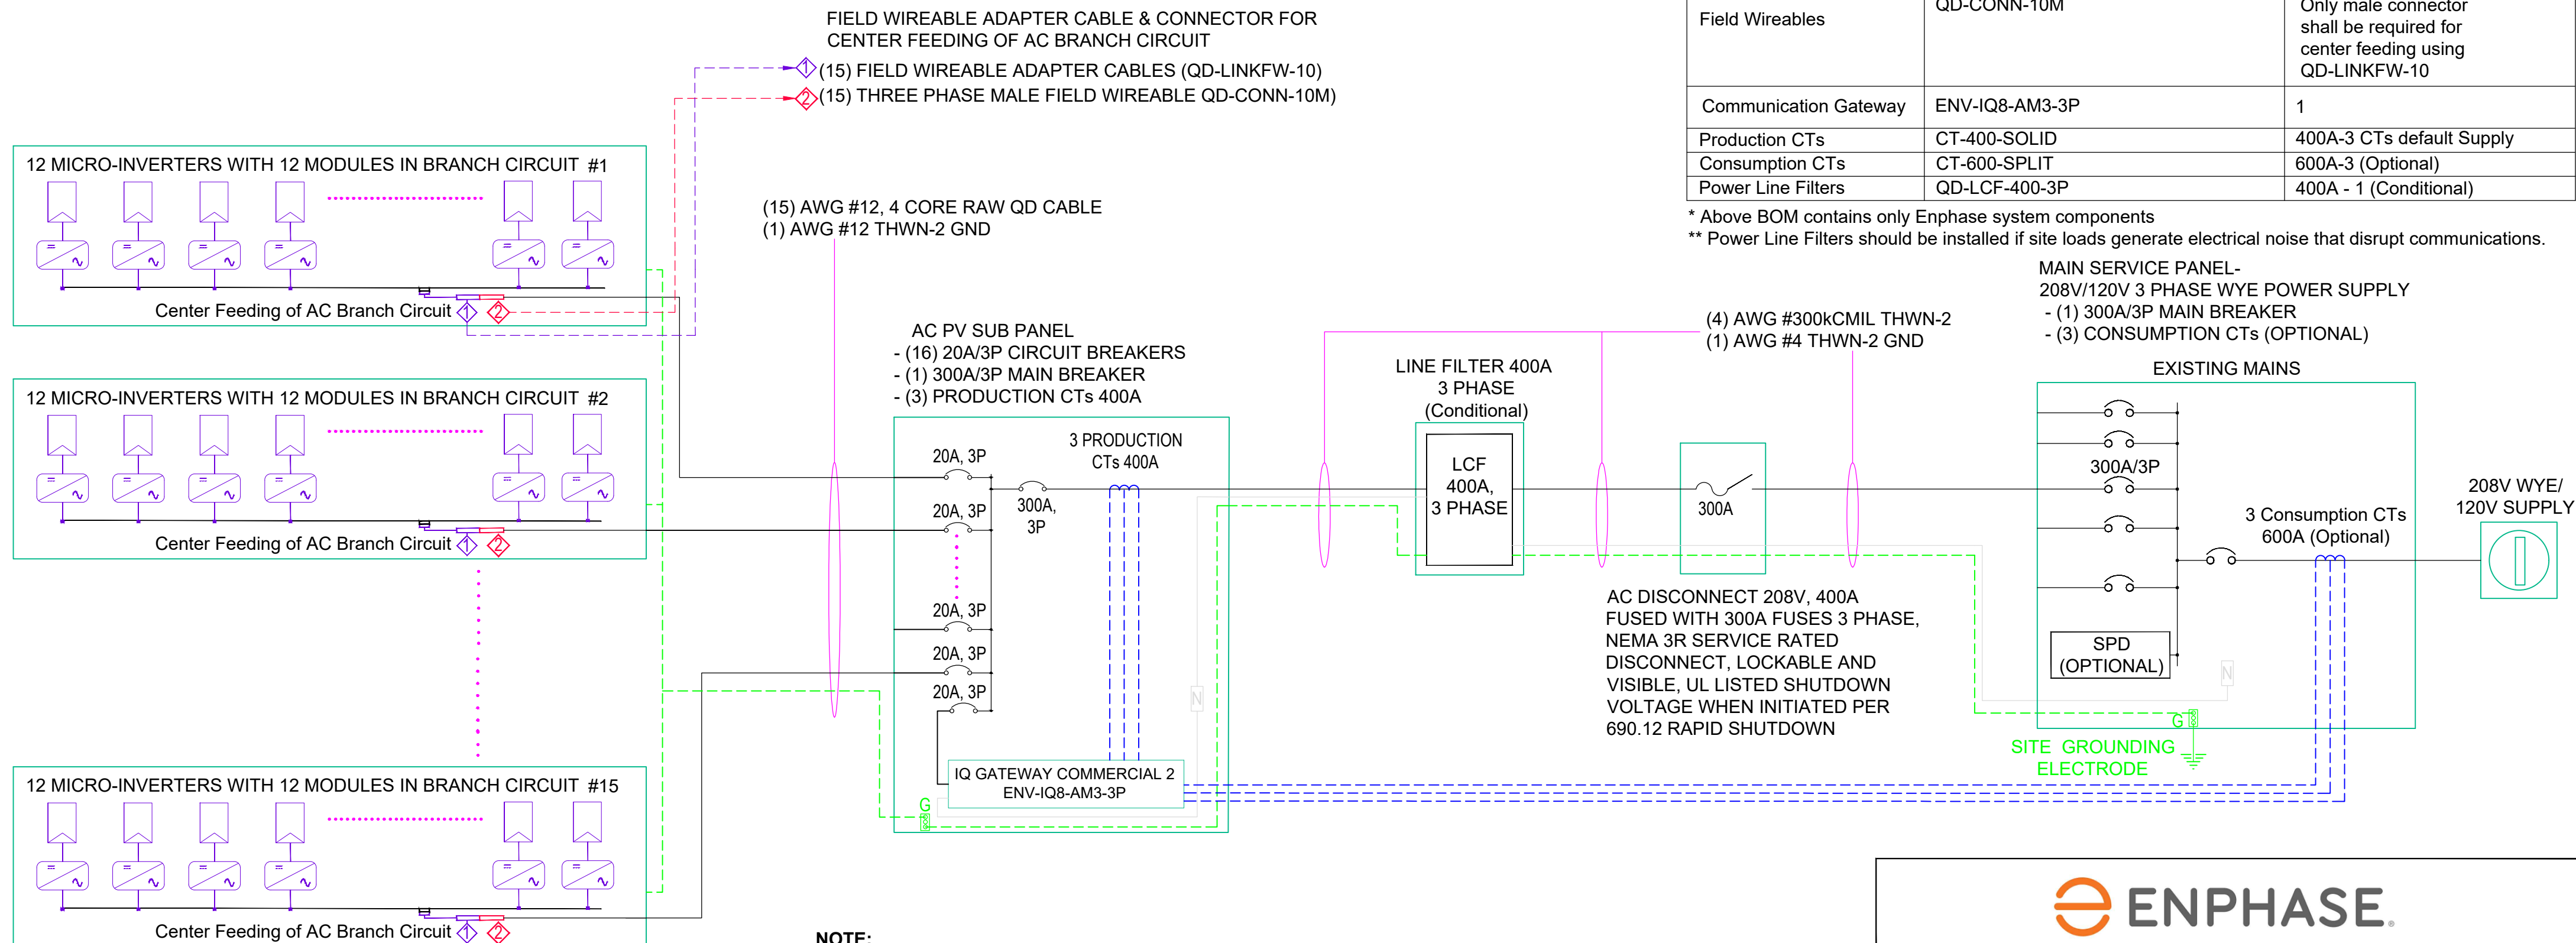

NOTE:
 THIS DOCUMENT IS PROVIDED FOR RECOMMENDATION AND SUGGESTIVE PURPOSE TO DEMONSTRATE ENPHASE IQ8P-3P SOLUTIONS AND PRODUCTS IN END USE ENERGY PROJECT APPLICATIONS. FINAL DESIGN AND ACTUAL PERFORMANCE OF ANY SOLAR ENERGY PROJECT AS WELL AS COMPLIANCE WITH ALL SPECIFICATIONS, INSTALLATION REQUIREMENTS AND LOCAL CODES IS THE RESPONSIBILITY OF THE PARTY THIS INFORMATION IS PROVIDED TO. THIS SINGLE LINE DIAGRAM IS NOT INTENDED TO REPLACE SITE SPECIFIC DIAGRAM FOR INSPECTION OF PROJECT. ENPHASE IS NOT RESPONSIBLE FOR USE OF THE DATA PROVIDED HEREIN.



DWG TITLE: TYPICAL IQ8P-3P 100kW SYSTEM SLD CENTER FEEDING	SIZE: A3
DATE: 12 AUG 2022	SHEET: 1 OF 1