

UL 9540A report summary of IQ Battery 5P

Model number: IQBATTERY-5P-1P-NA

SKU: B05-T02-US00-1-3 (Part No. 892-00024 Rev 92 and lower)

Contents

Result summary	2
BESS intended installation	2
Cell-level information.....	2
Cell-level gas composition	3
Module-level information.....	3
Gas composition and volume of each compound.....	3
Unit-level information.....	4
Unit testing:No external flaming or hazardous debris	4
No thermal runaway and re-ignitions post-test	4
No unit-to-unit or module-to-module propagation.....	4
Unit-level testing summary	4
External surrounding temperatures	5
Unit-level gas composition summary and minimum room size	5
Minimum separation distances	6
Conclusion.....	7
Revision history	8

Result summary

Information in this document is based on reports as defined by ANSI/CAN/UL 9540A, 4th Edition, November 12, 2019. The products were evaluated by UL Solutions.

Test report	Date of issue	Date of revision
Cell-level	2023-02-08	2023-10-19
Module-level	2023-02-23	2023-10-19
Unit-level	2023-02-28	2023-10-19

UL Solutions file numbers

- North America: [FTBW.E488100](#)
- Canada: [FTBW7.E488100](#)

BESS intended installation

Enphase IQ Battery 5P (Model number: IQBATTERY-5P-1P-NA, SKU: B05-T02-US00-1-3) was evaluated by UL Solutions to Standard ANSI/CAN/UL 9540A for outdoor and indoor non-habitable¹ residential spaces.

- Indoor (such as a two-car garage) wall-mounted and floor-mounted: Spaces including attached, detached, and open garages, which are well-ventilated and non-habitable.
- Outdoor wall-mounted and ground-mounted: Spaces that are out of direct sunlight and where the ambient temperature and humidity are within -4°F to 113°F (-20°C to 45°C) and 5% to 95% RH, non-condensing.

Cell-level information

Cell-level information	
Chemistry of the test item	Lithium iron phosphate (LiFePO ₄)
Was the cell certified?	Yes
Standard test item certified to	UL 1973
Organization that certified the test item	UL (BBGA2.MH62591)
Average cell surface temperature at gas venting under heater	331°F (166°C)
Average cell surface temperature at thermal runaway under heater	488°F (242°C)

¹ Habitable space is defined in the IRC as a space in a building for living, sleeping, eating, or cooking.

Non-habitable space is defined in the IRC as bathrooms, toilet rooms, closets, halls, storage or utility spaces, and similar areas.

Cell-level gas composition

Cell-level gas composition	Measured %
Carbon monoxide	6.9
Carbon dioxide	17.4
Hydrogen	60.9
Methane	4.5
Ethylene	3.5
Ethane	1.1
Acetylene	0.3
Propene (Propylene)	2.4
Propane	0.3
Propadiene	0.1
C ₄	1.1
Pentane	0.6
C ₆	0.3
C ₇	0.1
Benzene	0.2
Toluene	0.2
Styrene	0.1
Total	100

Module-level information

Module-level information	
Ratings	62.4 Ah, 76.8 V
Module cell configuration	24S1P
Module weight (kgs)	35
Module enclosure material	Polycarbonate, SPCC steel sheet, and aluminum
Was the module certified?	Yes
Standard the module was certified to	UL 1973
Organization that certified the test item	UL, File MH62591

Gas composition and volume of each compound

Module-level information		
Gas compound	Pre-flaming (L)	Flaming (L)
Total hydrocarbons (Propane equivalent)	937	No flaming occurred
Carbon dioxide	543	No flaming occurred
Carbon monoxide	47	No flaming occurred
Hydrogen	163	No flaming occurred

Unit-level information

Unit testing: No external flaming or hazardous debris

- No external flaming or debris hazards were observed.
- No evidence of flying debris was found in the test room after the conclusion of the test.
- The initiating unit was covered with a single layer of cheesecloth used as an ignition indicator. The cheesecloth did not ignite, and no flame was observed.

No thermal runaway and re-ignitions post-test

No additional thermal runaway behavior or re-ignitions were observed during post-test observation, disassembly, and sample disposal.

No unit-to-unit or module-to-module propagation

Unit-to-unit propagation was not observed because the target unit's temperature did not reach or exceed the cell venting temperature. The target unit temperature was 56°C, far below the cell venting temperature. Therefore, unit-to-unit propagation is not possible.

Module-to-module propagation does not apply because only one module is within the initiating unit.

Unit-level testing summary

Unit level information	Description
Model number	IQBATTERY-5P-1P-NA (B05-T02-US00-1-3)
Rated AC input/output power, kVA	3.84
BESS module configuration	1P1S (single module in the unit)
BESS intended installation Residential Indoor: Wall-mounted and floor-mounted Outdoor: Wall-mounted and ground-mounted Non-residential Indoor: Wall-mounted, floor-mounted, rooftop, open garage Outdoor: Wall-mounted and ground-mounted	Residential A well-ventilated, non-habitable indoor location (such as a two-car garage) Non-residential An outdoor location that is out of direct sunlight and where the ambient temperature and humidity are within -4°F to 113°F (-20°C to 45°C) and 5% to 95% RH, non-condensing
Residential indoor use: minimum room size	133 m ³
Was the unit certified?	Yes
Standard the unit was certified to	UL 9540
Organization that certified the unit	UL File FTBW.E488100 and FTBW7.E488100
External flaming from BESS	No external flaming
Location(s) of flame venting	No external flaming
Heat flux measurement	A cheesecloth ignition indicator was used in accordance with CRD. No flaming or charring of the cheesecloth ignition indicator was observed.

Maximum target BESS temperature	133°F (56°C)
Maximum wall surface temperature	244°F (198°F rise above the ambient)
Flying debris	No flying debris
Re-ignition	No re-ignition

External surrounding temperatures

Surrounding temperature	Value
Maximum temperature to target	133°F (56°C)
Maximum wall temperature, absolute	244°F (198°F rise above the ambient)
Maximum wall temperature, delta (79°F ambient)	198°F (92°C)

Unit-level gas composition summary and minimum room size

Gas component	Gas type	During pre-flaming (L)	During flaming (L)
Total hydrocarbons (Propane equivalent)	Hydrocarbons	1393.88	No flaming
Carbon dioxide	Carbon containing	0.06	No flaming
Carbon monoxide	Carbon containing	0.41	No flaming
Hydrogen	Hydrogen	251.23	No flaming
Minimum room size based on 25% LFL		133 m ³	

Minimum separation distances

The following figure shows spacings between the IQ Battery 5P units as evaluated in the UL 9540A report.

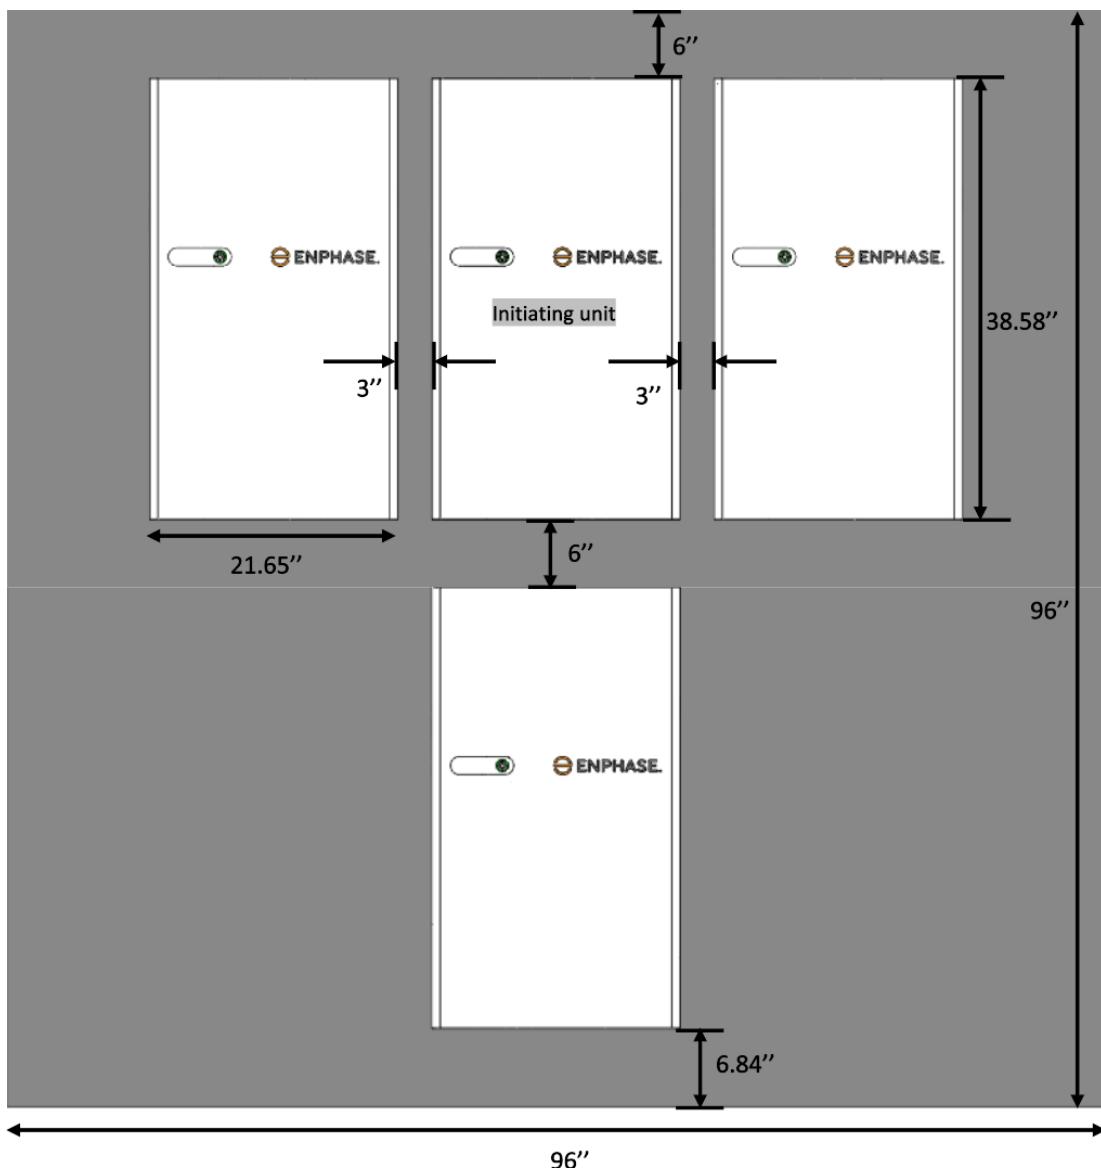


Figure 1: Spacings between the IQ Battery 5P units

The following figure shows the initiating unit in the middle covered with a cheesecloth. Two target units are on the sides, and one is below the initiating unit.



Figure 2: Initiating unit in the middle covered with cheesecloth together with the target units

Conclusion

The IQ Battery 5P product passed the UL 9540A unit-level test. The peak wall surface and target unit temperatures were below the limits, and no ignition events were observed during and after the completion of the test.

Revision history

Revision	Date	Description
TEB-00097-2.0	March 2024	Added part number.
TEB-00097-1.0	October 2023	Initial release.

© 2024 Enphase Energy. All rights reserved. Enphase, the e and CC logos, IQ, and certain other marks listed at <https://enphase.com/trademark-usage-guidelines> are trademarks of Enphase Energy, Inc. in the U.S. and other countries. Data subject to change.