


## Getting Started Guide: Terminal Block Wiring for the Envoy-S, IQ Envoy, and IQ Combiner 3 / 3C


This guide is for the solar energy professional who will install the Enphase Envoy-S Metered™, the Enphase IQ Envoy™, the Enphase IQ Combiner 3™ or the Enphase IQ Combiner 3C™ and current transformers (CTs). Refer to the appropriate Installation and Operation Manual for complete installation instructions and safety warnings.

### Envoy-S Metered (ENV-S-AM1-120 M)

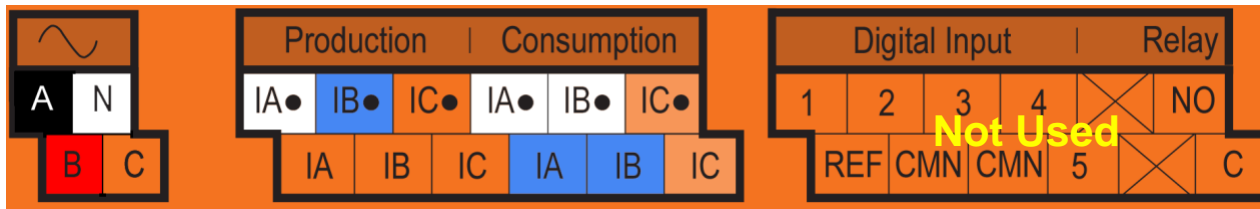

- All terminal wiring will be completed on the job site.
- The Production CT must be fed by Service Line 1.

### IQ Envoy (ENV-IQ-AM1-240) and IQ Combiner 3 (X-IQ-AM1-240-3) and IQ Combiner 3C (X-IQ-AM1-240-3C)

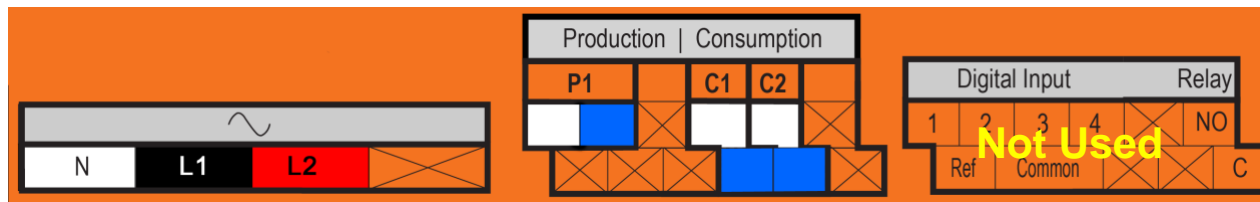

- Power terminal and Production CT terminals are pre-wired in the IQ Combiner 3 and the IQ Combiner 3C.
- Consumption CT terminals will be wired on the job site.